


FIG. 4

5/15

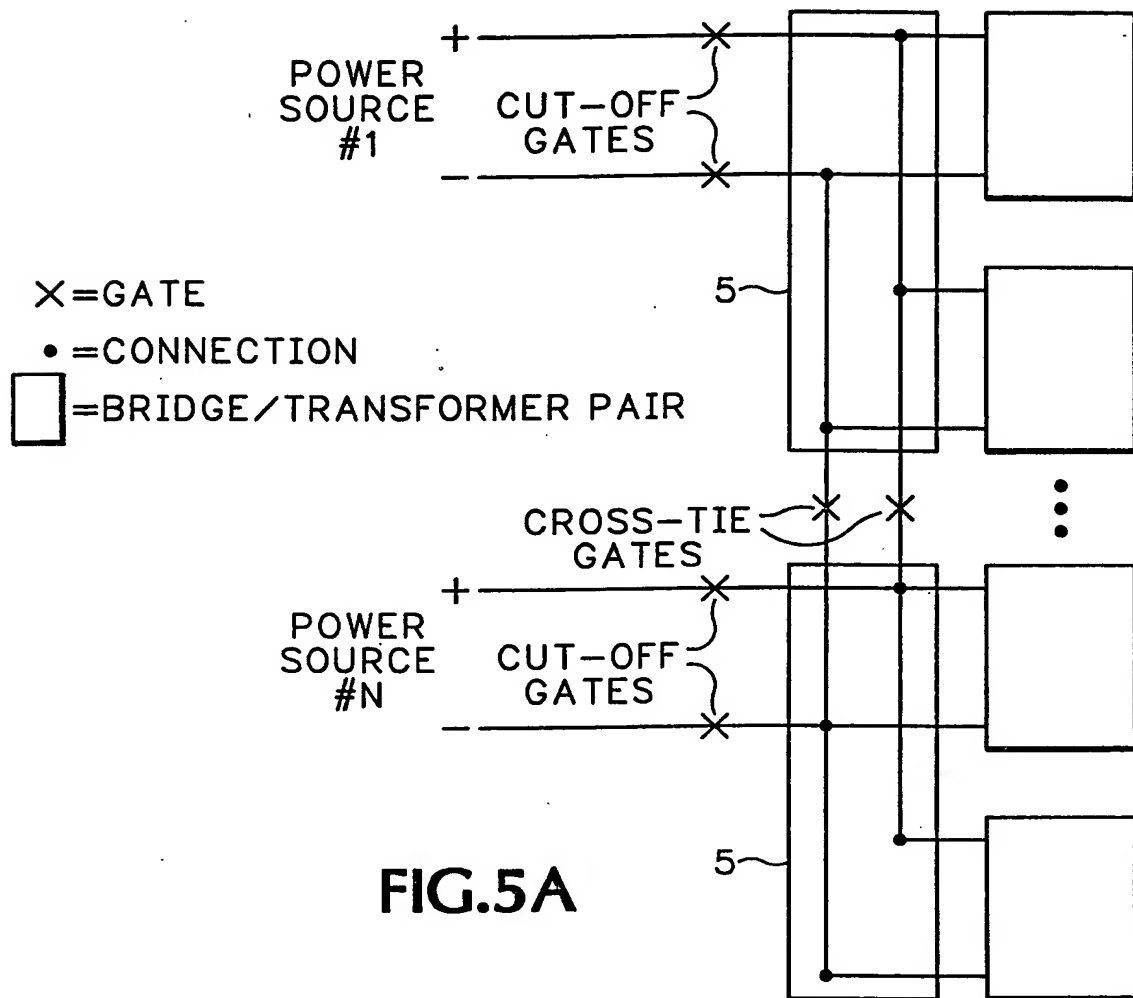

6/15



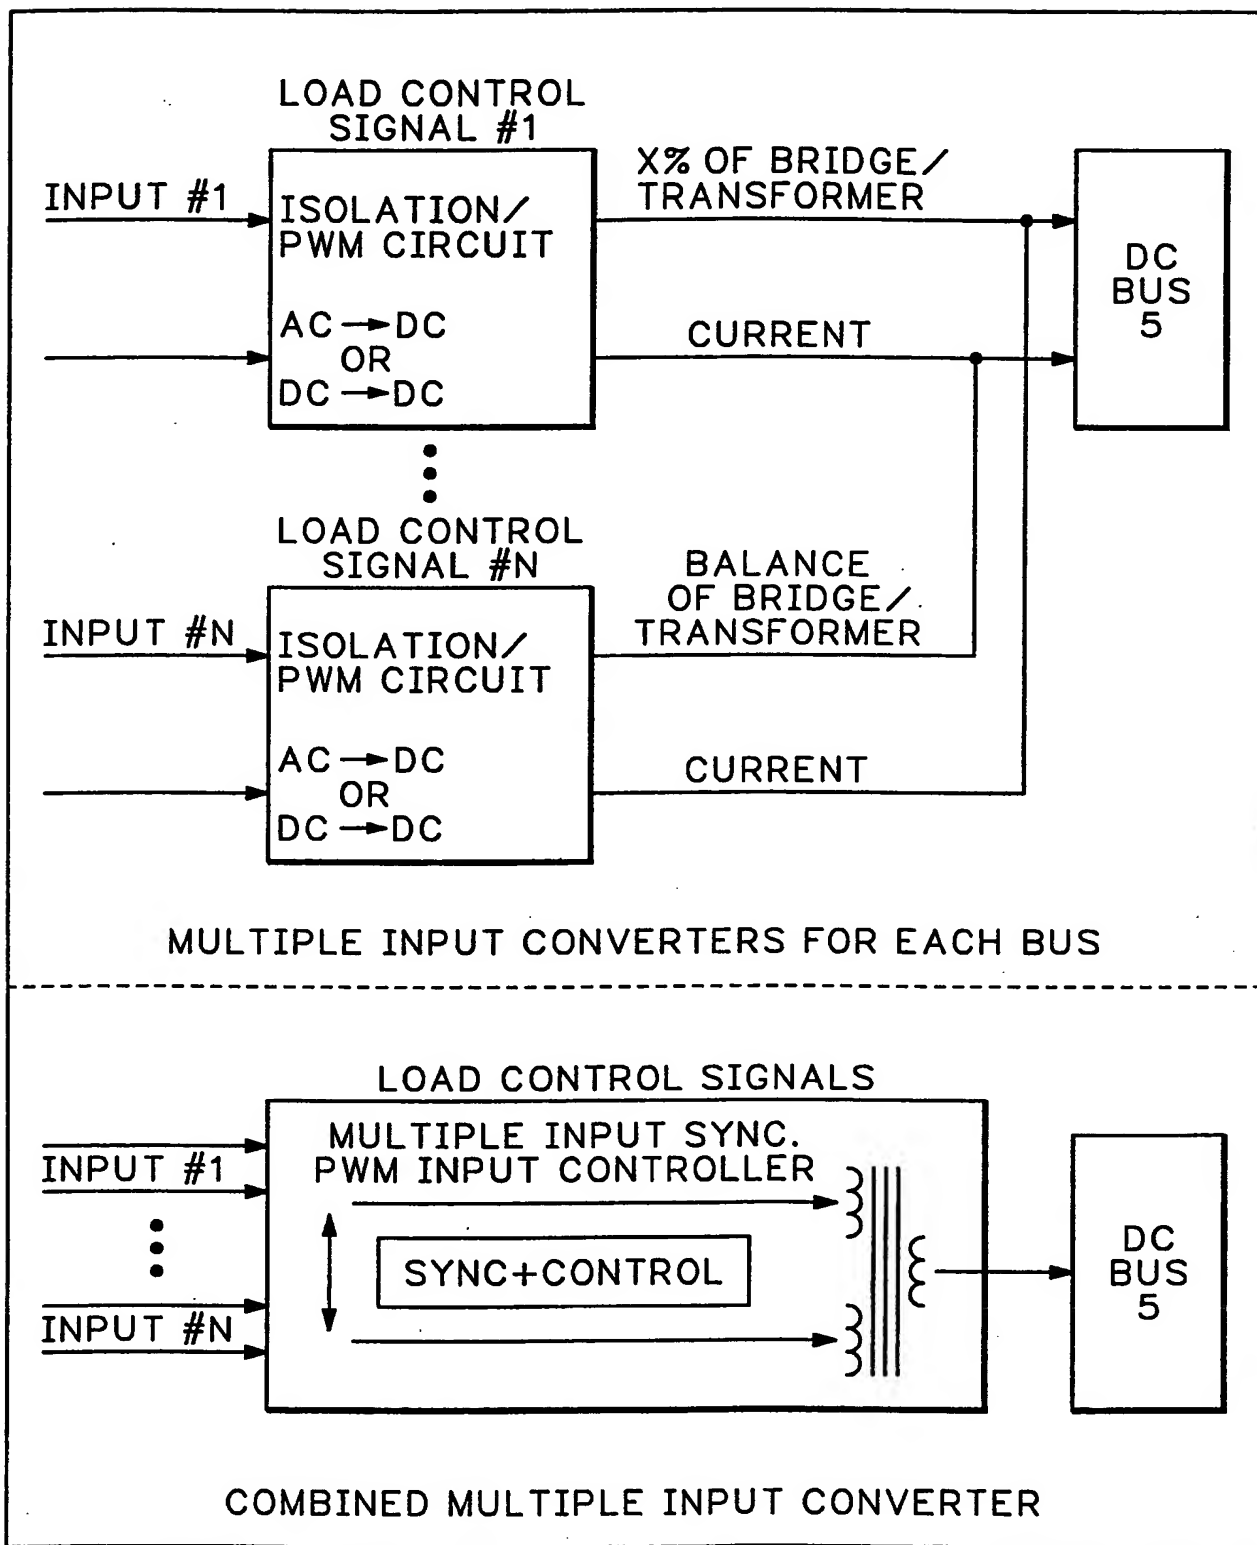


FIG.5B


7/15

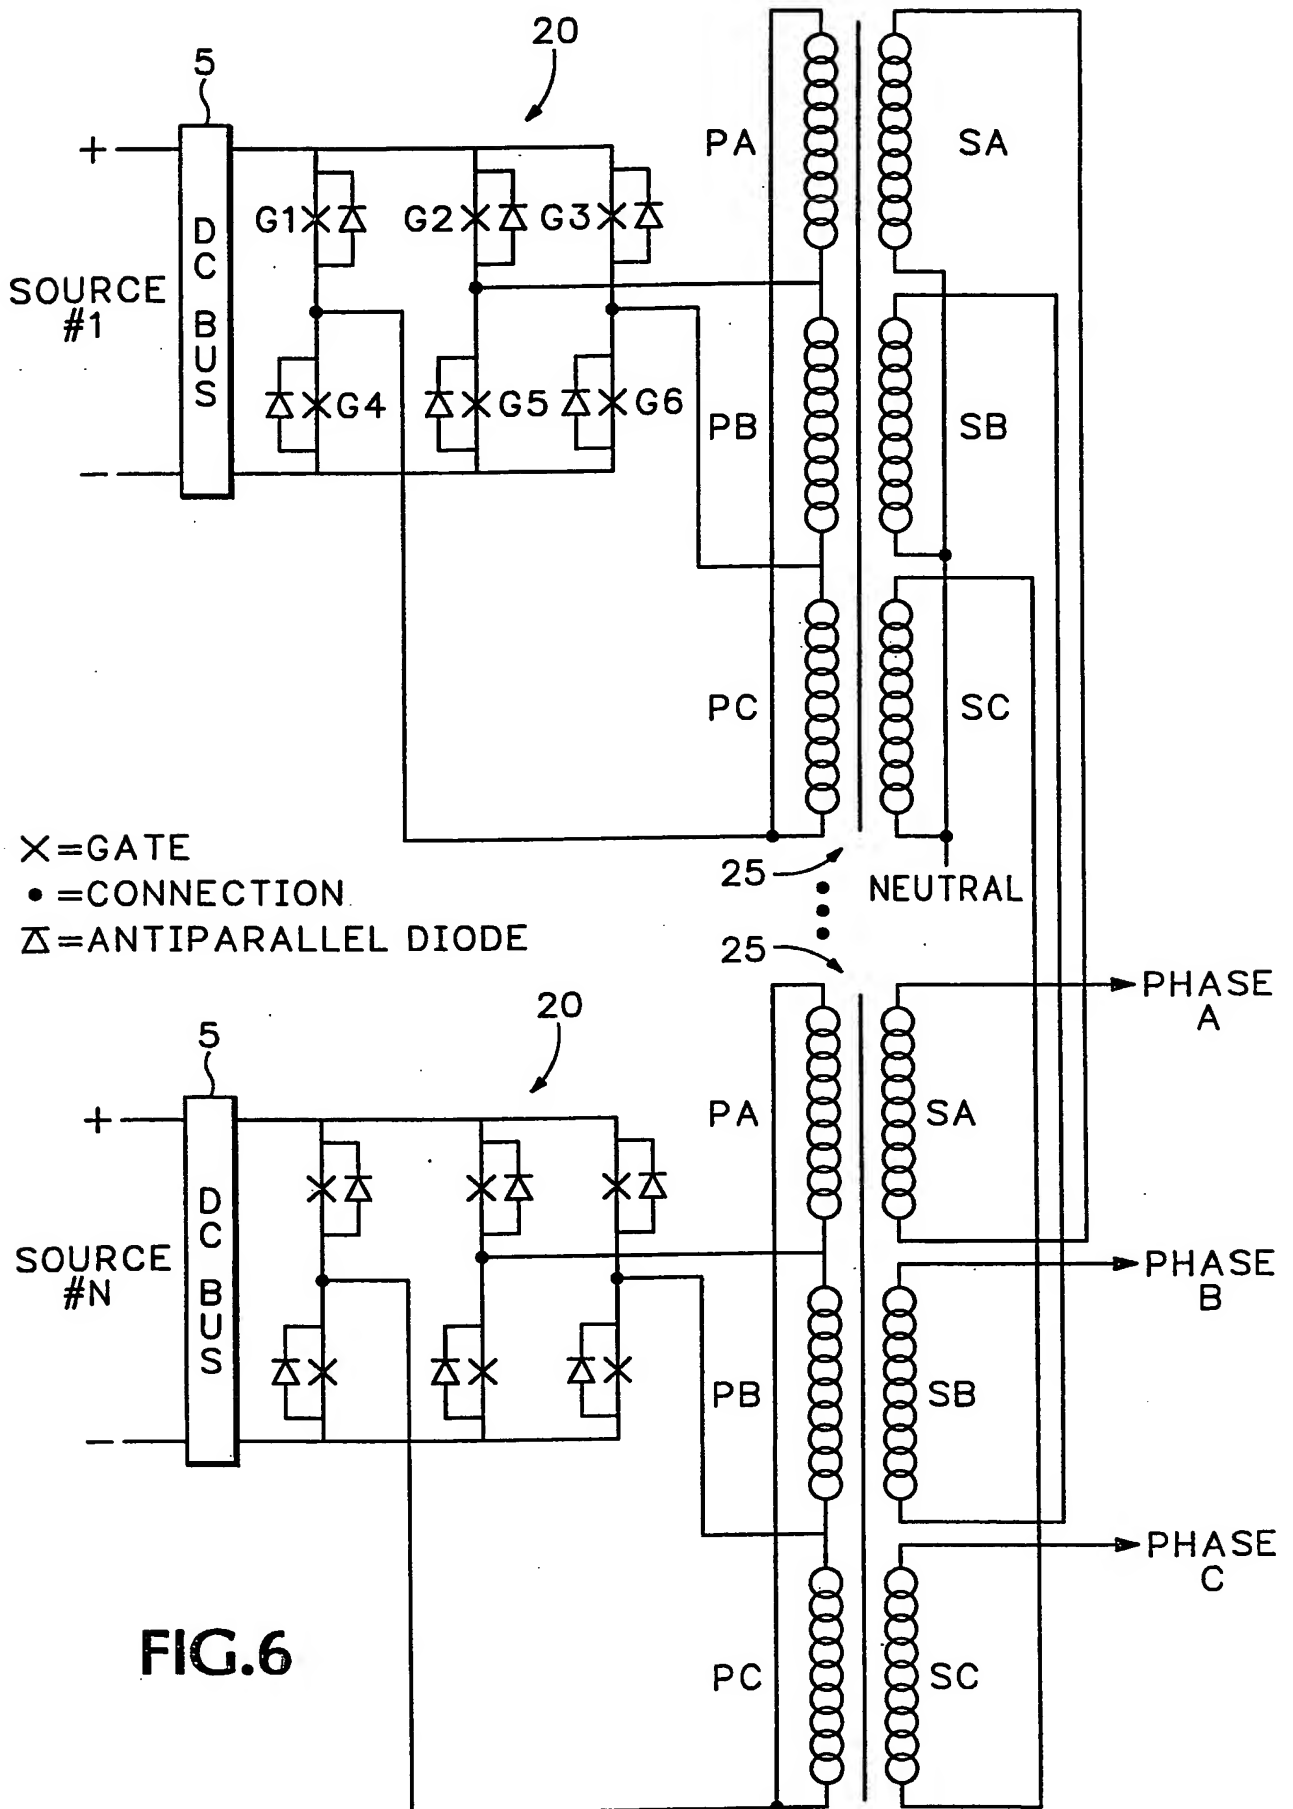

8/15

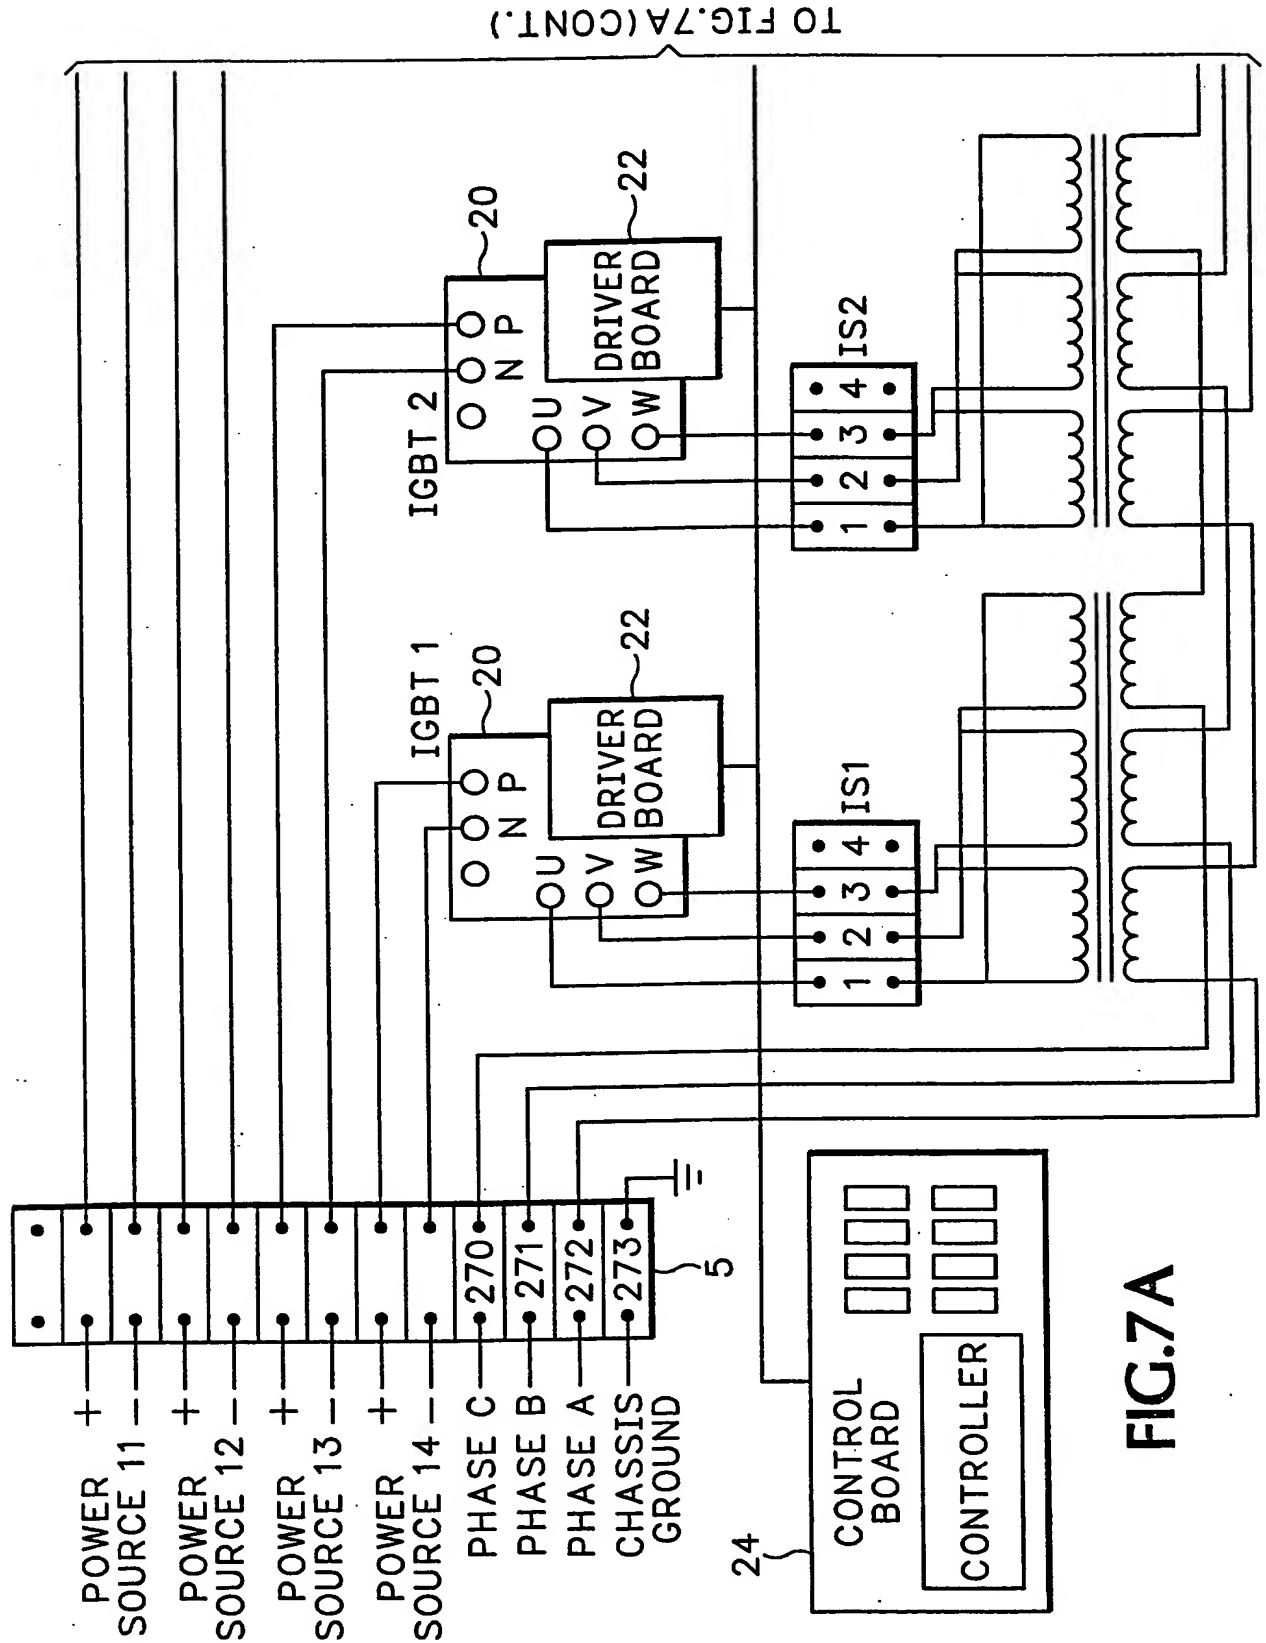

9/15

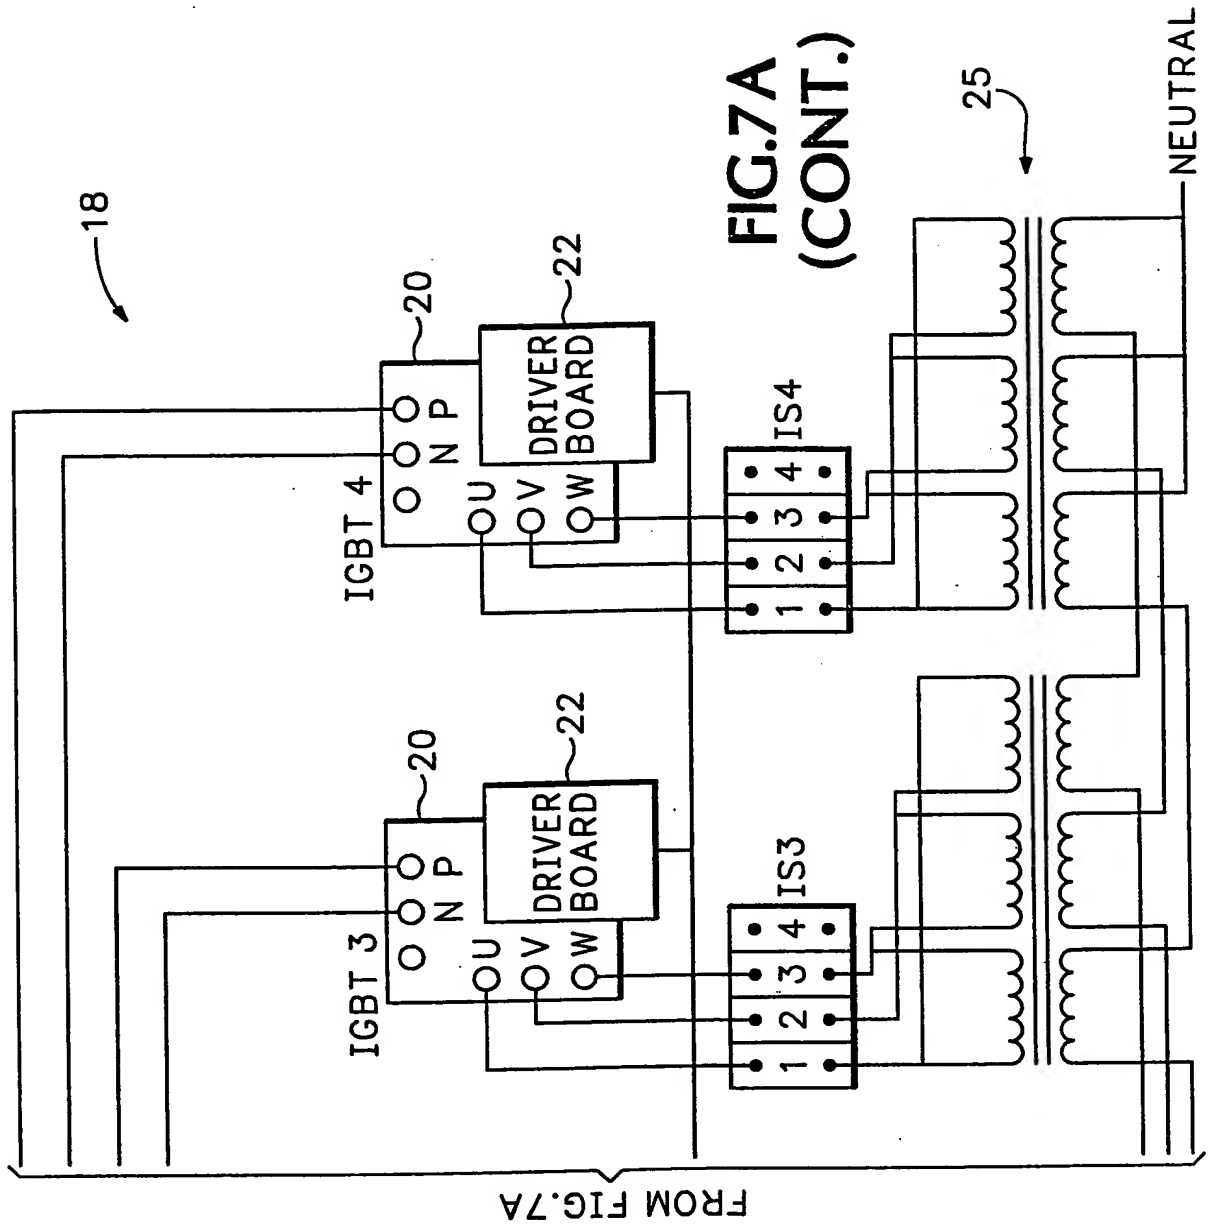

10/15


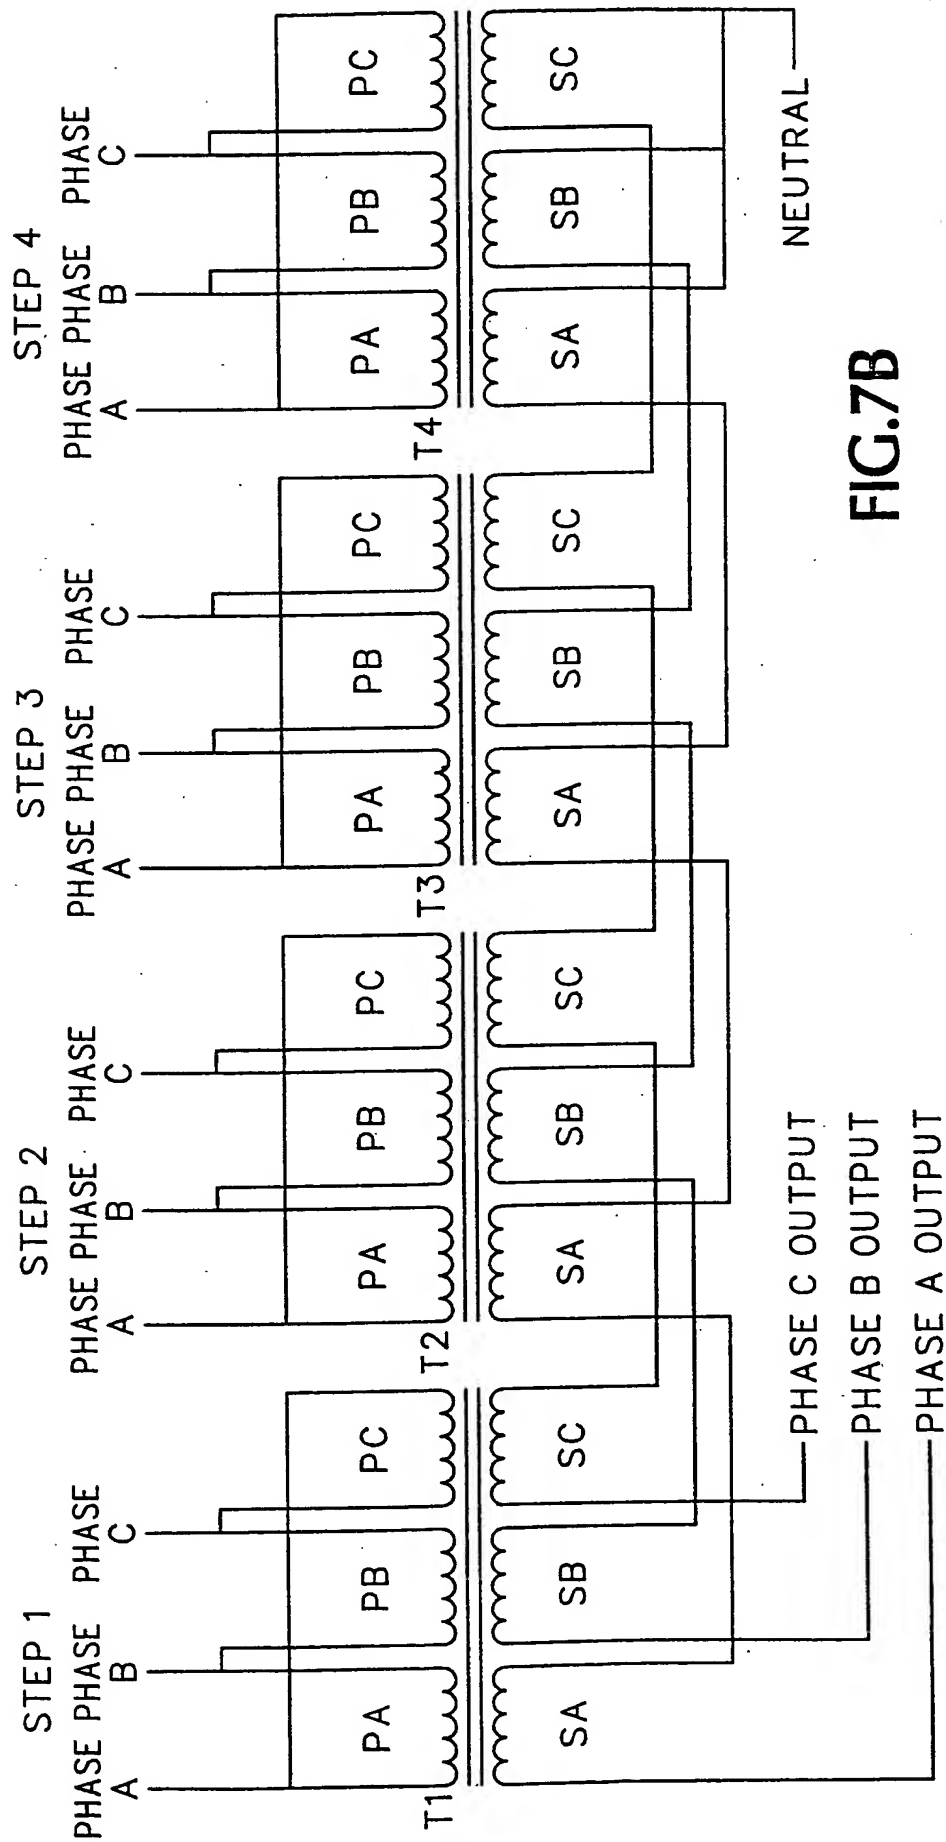


FIG.7B

11/15

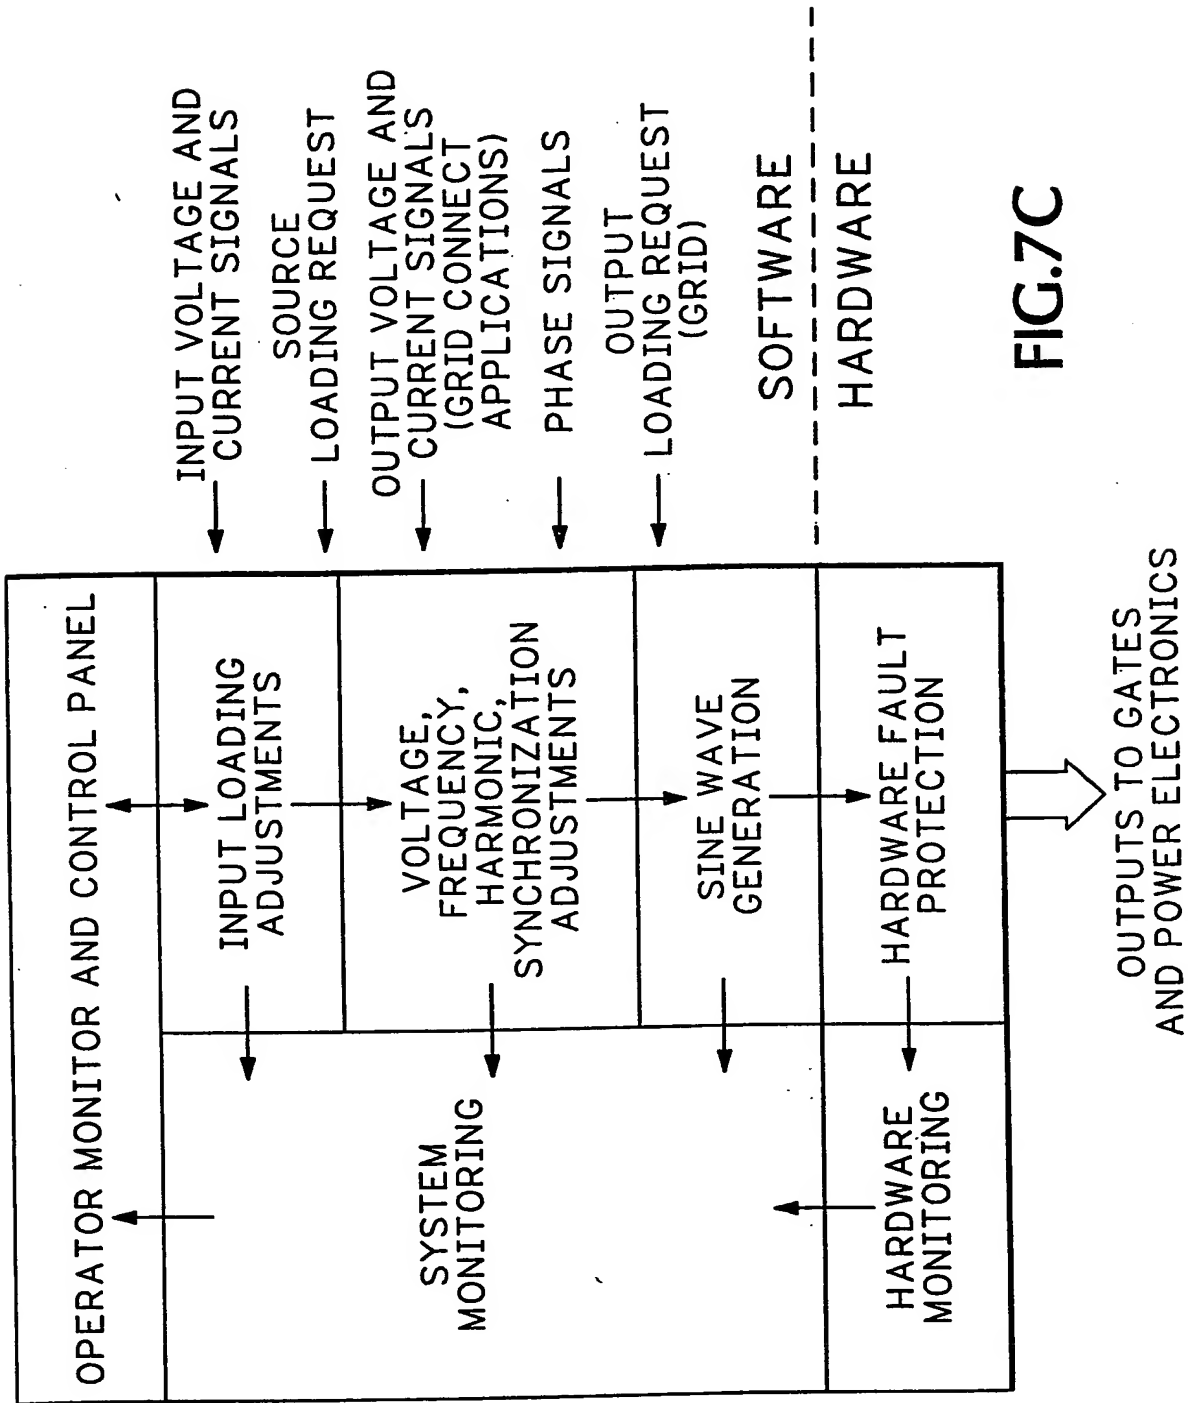

12/15


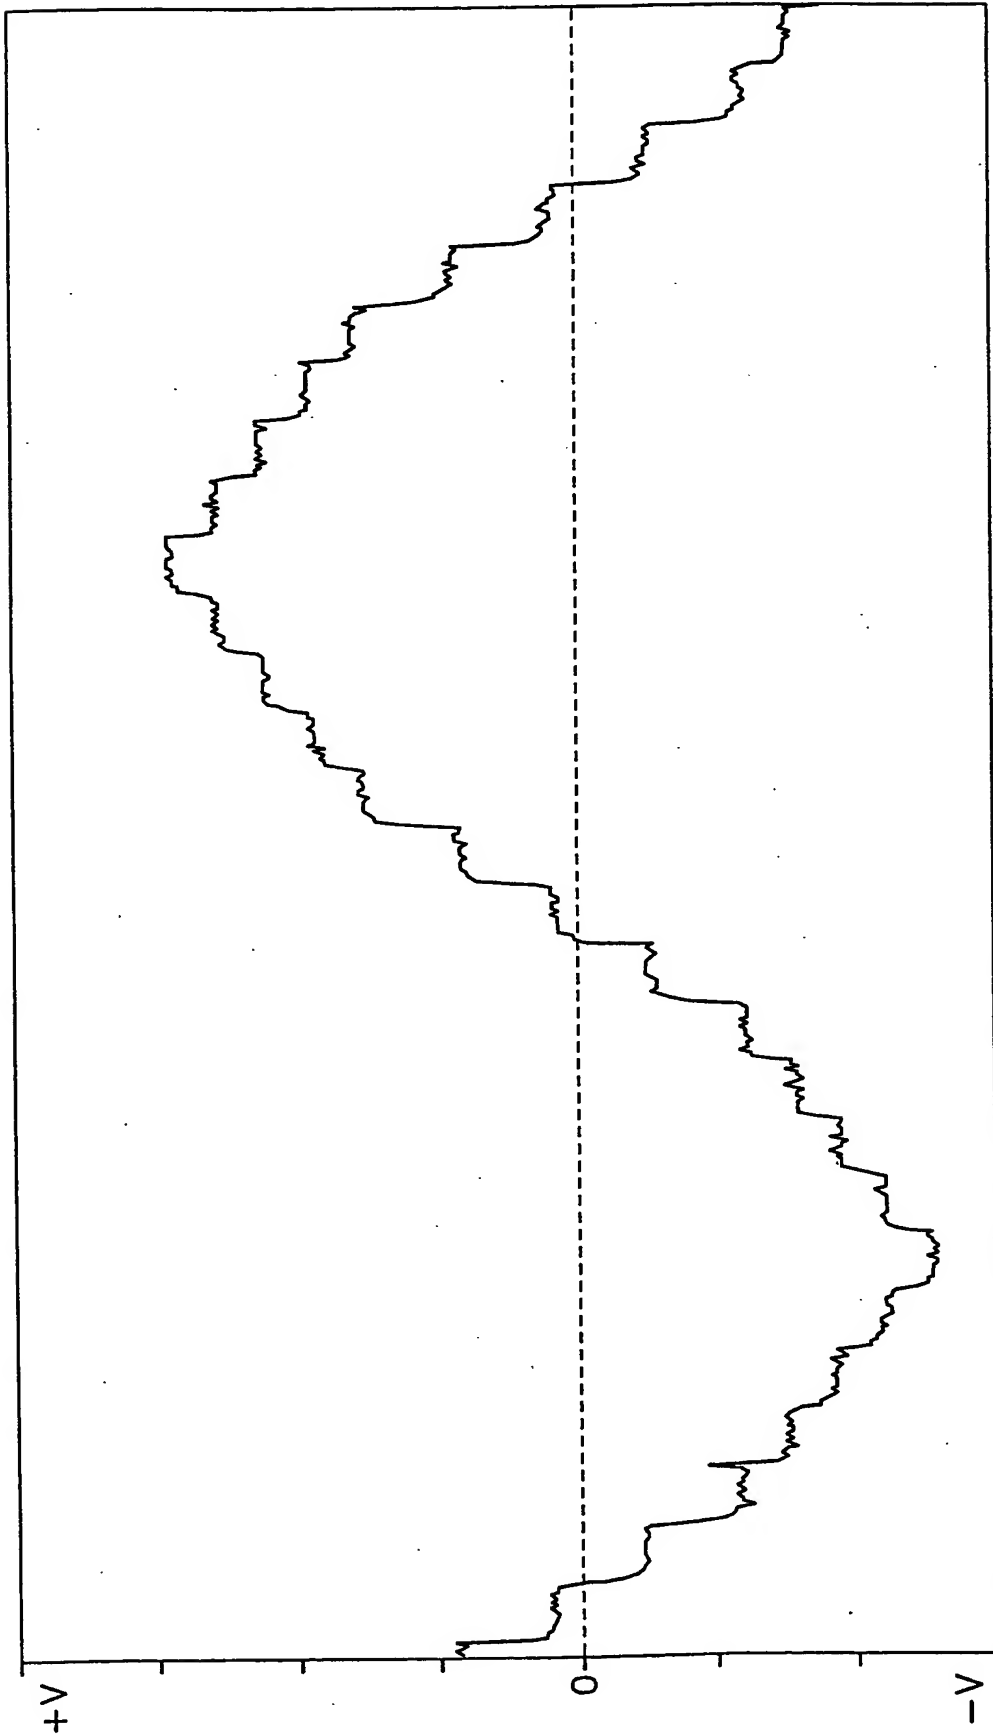


FIG.8

13/15

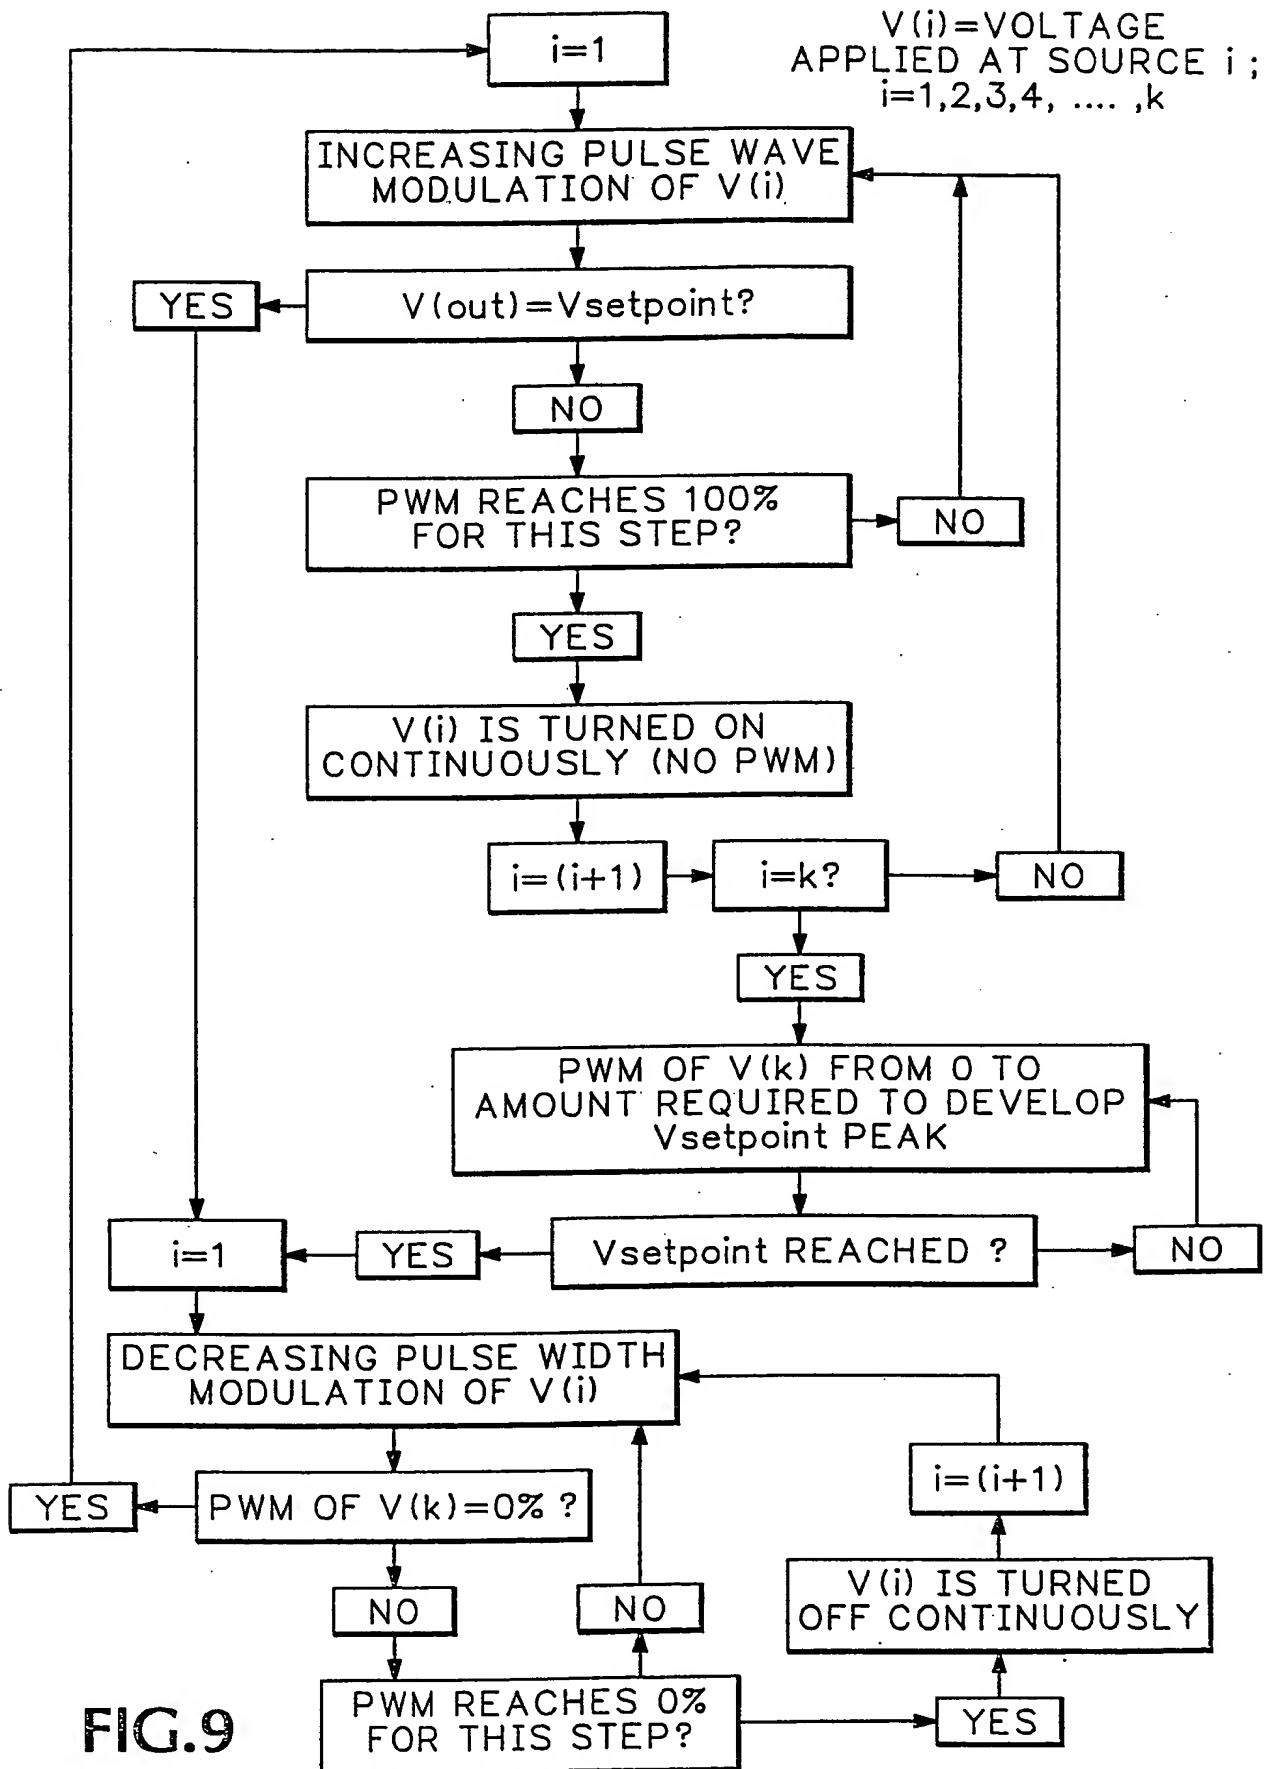

14/15

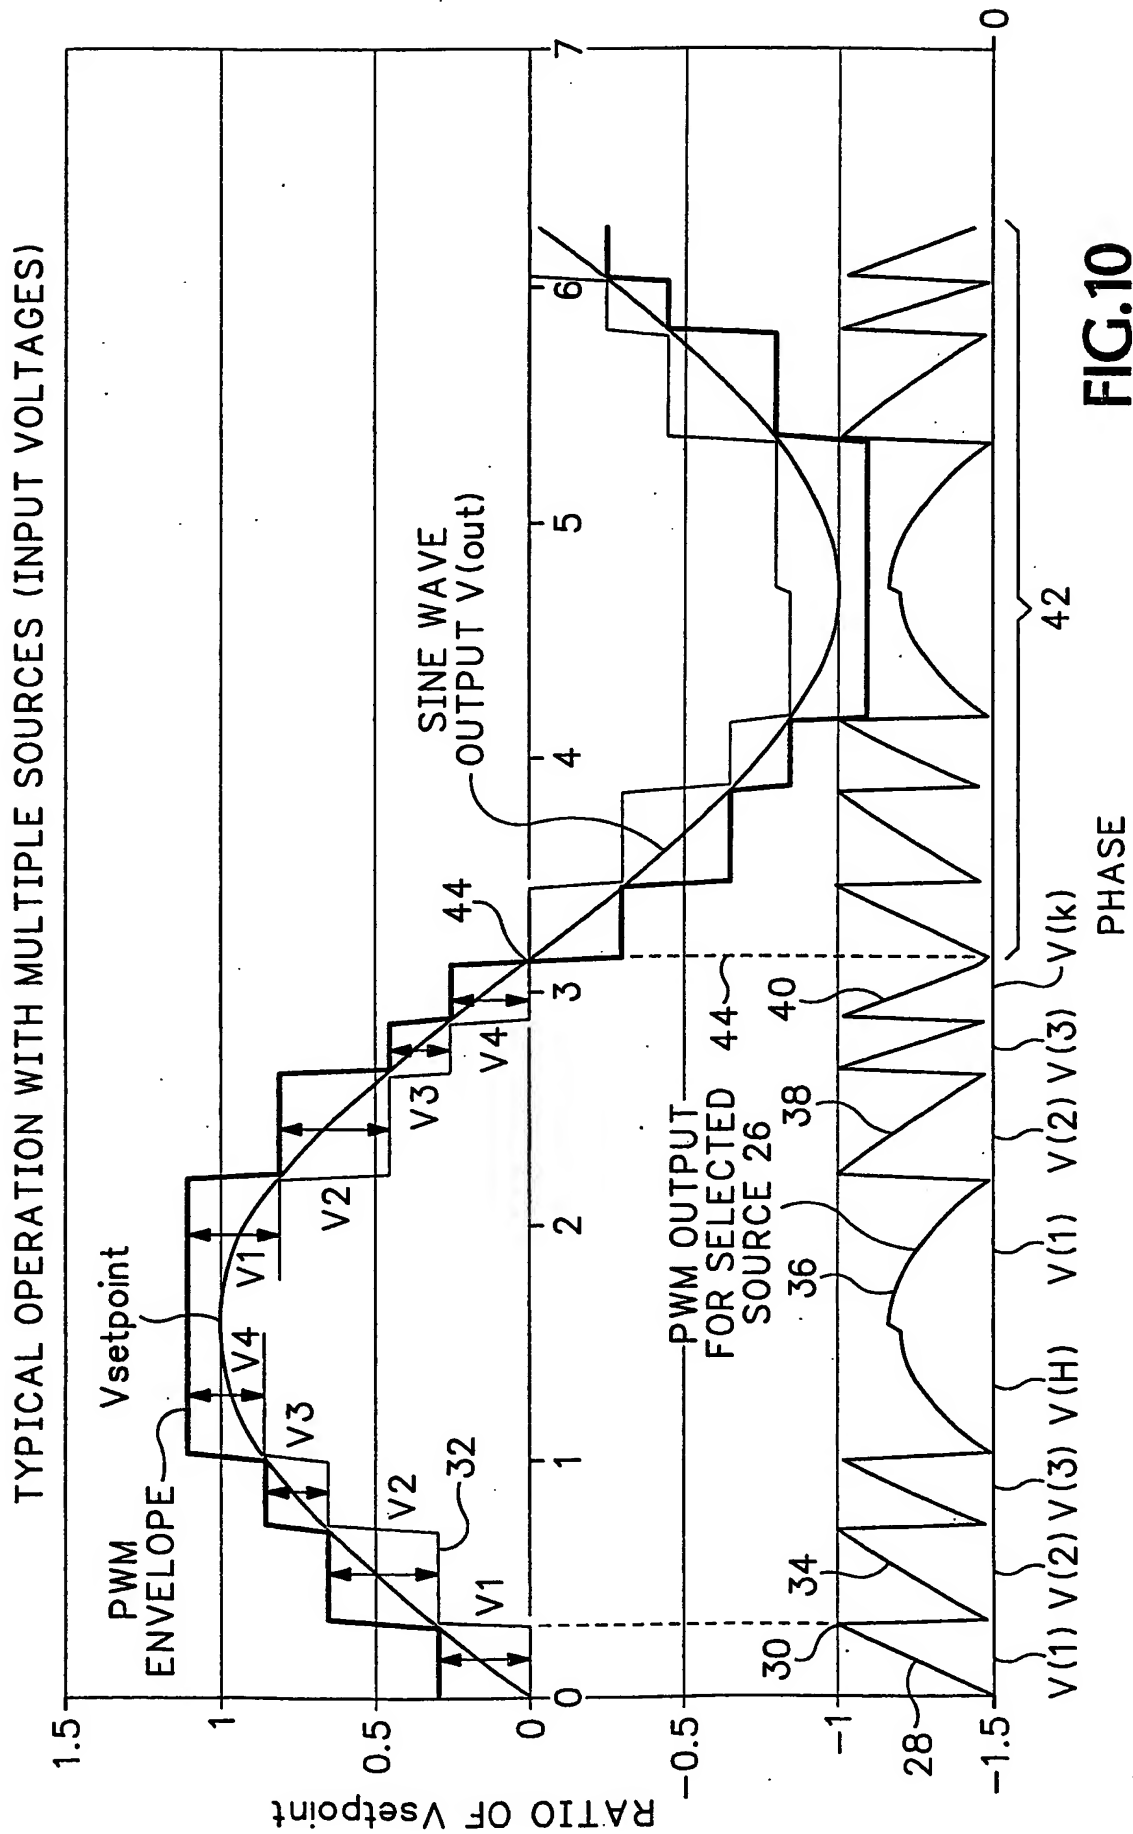


FIG.10

15/15

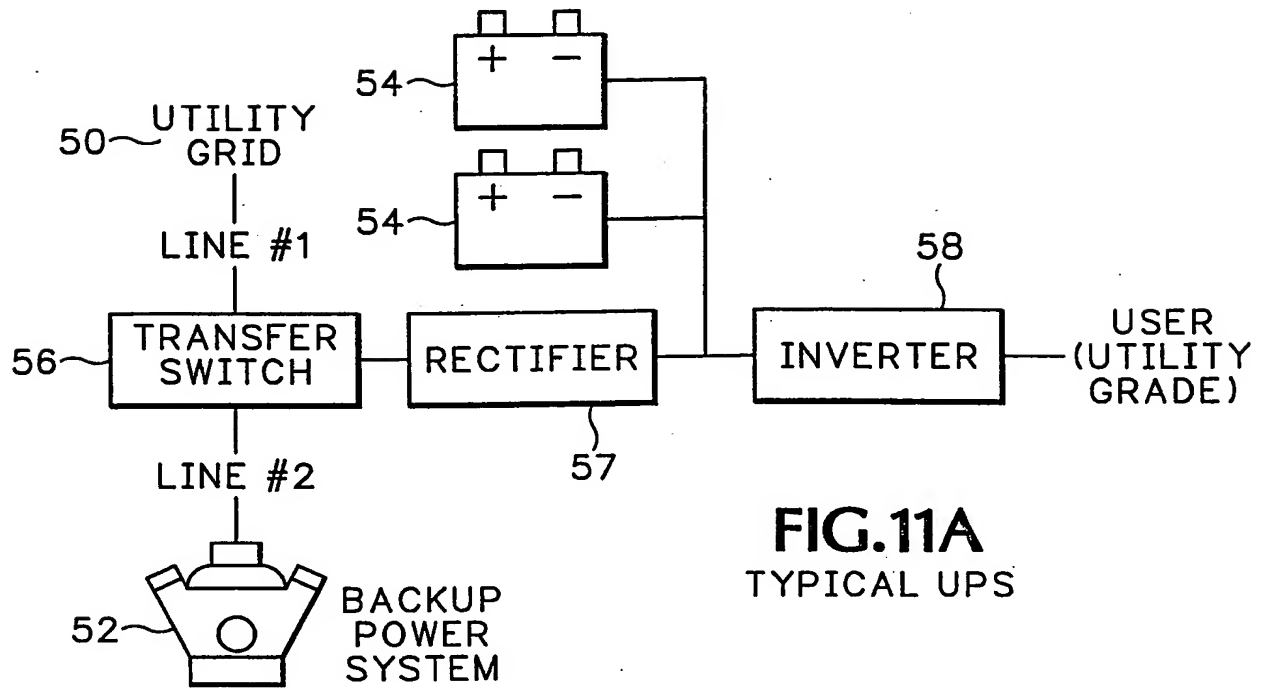


FIG. 11A
TYPICAL UPS

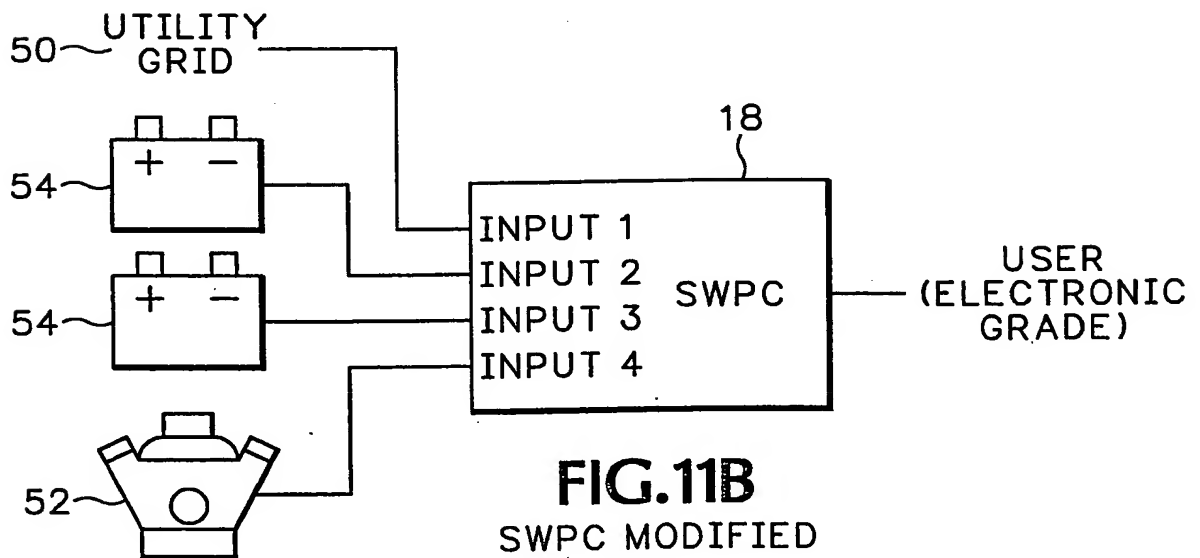


FIG. 11B
SWPC MODIFIED